#### Prüfinstitut Hoch

Lerchenweg 1 D-97650 Fladungen Tel.: int – 49 – 9778-7480-200 hoch.fladungen@t-online.de

www.reaction-to-fire.de



Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch Testing, supervising and certifying body, authorized by the building supervision authority

# TEST REPORT PZ-Hoch-221126-2

for the proof of Fire behaviour according to DIN 4102, part 1 Translation of the German test report – no guarantee for translation of technical terms

company

KOBEFAB INTERNATIONAL BV

De vest 62

NL-5555 XP Valkenswaard

description of samples

fabric consisting of 51% Trevira and 49% Polyester, in 3 different

colours

name of the material

"Alpha CS"

sampling

by the company itself

content of request

Proof of flammability to classify building materials to class B1

"schwerentflammbar" according to DIN 4102, part 1

validity of test report

30.11.2027

result

The examined product meets in any colour the requirements of class B1 for "schwerentflammbare" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998), suspended freely or with distance of >40 mm to same or other plain

materials.

The examined product shows burning droplets.

This test report includes 5 pages and 7 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:


- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval ) or by
- "allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by "Zustimmung im Einzelfall" (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non-regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.





#### 1. Description of test material in condition as delivered

PN 36007: "Alpha CS" colour: white

-fabric consisting of 51% Trevira and 49% Polyester-

side A: smooth, glossy

characteristic values determined by the test laboratory:

area weight: about 260g/m²

thickness: about 0,52mm

PN 36008: "Alpha CS" colour: red

-fabric consisting of 51% Trevira and 49% Polyester-

side A: smooth, glossy

characteristic values determined by the test laboratory:

area weight: about 271g/m²

thickness: about 0,50mm

PN 36009: "Alph

"Alpha CS" colour: black

-fabric consisting of 51% Trevira and 49% Polyester-

side A: smooth, glossy

characteristic values determined by the test laboratory:

area weight: about 284g/m²

thickness: about 0,55mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

#### 2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

#### 3. Arrangement of samples mounting: freely suspended

#5945:	flaming side A in warp direction	red
#5946:	flaming side B in warp direction	red
#5947:	flaming side B in weft direction	red
#5949:	flaming side B in warp direction	black
#5950:	flaming side B in weft direction	white

#### 4. Date of test CW 49 in 2022



### 5. Results The test has been examined according to DIN 4102 (Mai 1998)

	Measurement	Res	ult with the	tested spe	cimen		Dim.
6.	Test number	#5945	#5946	#5947	#5949	#5950	
line	colour of fabric		red		black	white	
	flaming direction / side	warp / A	warp / B	weft / B	warp / B	weft / B	
1	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	
2	Maximum flame height above bottom edge of the specimen Time 1)	30 0:02	30 0:02	30 0:02	30 0:02	40 0:03	cm min:s
4	Burn through / melting Time 1)	0:04	0:04	0:04	0:04	0:03	min:s
5	Observations on the back side of the specimen Flames / Glowing Time <sup>1)</sup> Change of colour Time <sup>1)</sup>	 .J.  .J.	 J. 	./. ./. ./.	./. ./. ./.	 ./. 	min:s
7	Falling of burning droplets Start 1)	./.	J.	./.	J.	./.	
8 9	Extent sporadic falling of burning droplets 2) continuous falling of burning droplets 2)						min:s
10	Falling of burning droplets Start 1) Extent sporadic falling of burning droplets 2)	./.	J.	./.	./.	./.	min:s
II	continuous falling of burning droplets <sup>2)</sup>						
13	After flame time at the bottom of the sieve (max.)	./.	.J.	./.	./.	./.	min:s
14	Impairment of the burner by dropping or falling material: Time 1)	J.	J.	./.	./.	./.	min:s
15	Final occurrence of burning at the specimen 1)	0:30	1:05	1:05	1:10	0:52	min:s
16	Time of eventually end of test 1)	.J.	./.	.J.	J.	./.	min:s
17 18 19 20 21	After flame after end of test Time 1) Number of specimen Front side of specimen 2) Back side of specimen 2) flame length	.J. .J. .J. .J.	.I. .I. .I. .I.	J. J. J. J.	J. J. J. J.	.I. .I. .I. .I.	min:s

	Measurement	Res	ult with the	tested spec	cimen		Dim.
ine no.	Test number	#5945	#5946	#5947	#5949	#5950	
line	colour of fabric		red		black	white	
	flaming direction / side	warp / A	warp / B	weft / B	warp / B	weft / B	
22	Afterglow after end of test Time 1)	.J. .J.	./. ./.	. <i>I</i> . . <i>I</i> .	./. ./.	.J. .J.	min:s
23	Number of specimen	./.	./.	./.	./.	./.	
	Place of appearance	.J.	.J.	.J.	.J.	./.	
24 25	Lower half of the specimen 2) Upper half of the specimen 2)	./. ./.	./. ./.	./. ./.	./. ./.	./. ./.	
	Front side of specimen 2)	./. ./.	./. ./.	./. ./.	./. ./.	./.	
27	Back side of specimen 2)	./.	./.	./.	./.	./.	
28 29	<u>Density of smoke</u> ≤ 400 % * min > 400 % * min <sup>4)</sup>	1 ./.	1 ./.	1 ./.	1 ./.	1 ./.	% * min % * min
30	Diagram: encl. no.	1	2	3	4	5	
31	Residual lengths: individual value <sup>3)</sup> Specimen 1 Specimen 2	67 64	64 63	63 66	66 63	62 60	cm cm
	Specimen 3	75	71	62	66	67	cm
	Specimen 4	77	68	76	67	73	cm
32	Average value, individual test 3)	71	67	67	66	66	
	Photo of specimen in enclosure no.	1	2	3	4	5	
34		121	126	125	124	123	°C
35	Maximum of average value Time 1)	09:51	10:00	10:00	10:00	09:42	min:s
36	Diagram: encl. no.	1	2	3	4	5	
37	Remarks: - none -		2)				

indication of times: from the begin of testing procedure <sup>2)</sup> checked off if applicable indication of carrier/foam layer separated in case of fire-proofing agents very strong development of smoke

#### 6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

#### 7. Summary of results and additional establishments to Fire Behaviour

ō.	measurement	Res	Result with the tested specimen										
lineno.	test-no.	#5945	#5946	#5947	#5949	#5950	di E						
_ =		warp / A	warp / B	weft / B	warp / B	weft / B							
	colour of fabric		bred	black	white								
1	residual length	71	67	67	66	66	cm						
2	max. smoke temperature	121	126	126	124	123	°C						
3	density of smoke - integral	1	1	1	1	1	%min						
4	remarks: -none-												

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

#### 8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
  - o regular building materials for the required proof of accordance
  - o for not regular building materials for the required proof of applicability

#### 9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 22.12.2022

Il Dee Z

clerk in charge:

Head of the test laboratory:

(Silke Biendara)

(Dipl.-Ing.(FH) Andreas Hoch)

#### 6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

#### 7. Summary of results and additional establishments to Fire Behaviour

o j	measurement	Res	Result with the tested specimen										
ineno.	test-no.	#5945	#5946	#5947	#5949	#5950	di						
=		warp / A	warp / B	weft / B	warp / B	weft / B							
	colour of fabric		bred		black	white							
1	residual length	71	67	67	66	66	cm						
2	max. smoke temperature	121	126	126	124	123	°C						
3	density of smoke - integral	1	1	1	1	1	%min						
4	remarks: -none-												

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

#### 8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
  - o regular building materials for the required proof of accordance
  - o for not regular building materials for the required proof of applicability

#### 9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.


Fladungen, 22.12.2022

clerk in charge:


(Silke Biendara)


Head of the test laboratory:


(Dipl.-Ing.(FH) Andreas Hoch)

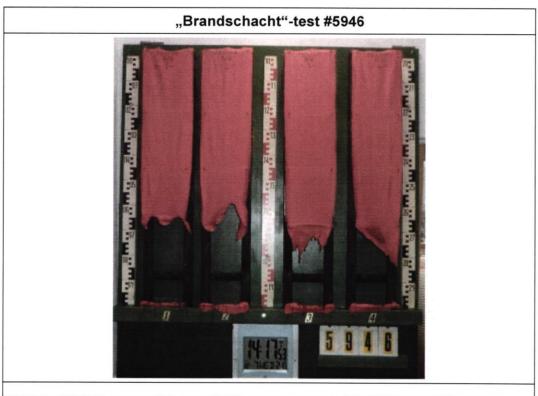


#### measurement #5946, PN36008: Kobefab, "Alpha CS", BK Max. flue temperature: 126°C, Smoke density integral: 1%min Residual length: 67 cm 200 100 90 Flue gas temperature [°C] 80 😤 150 70 60 50 40 t attenuation [ 100 30 € 50 20 10 0 0 0 2 8 Test duration 10 min

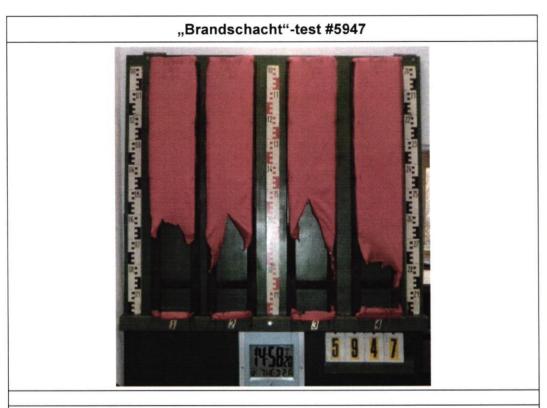

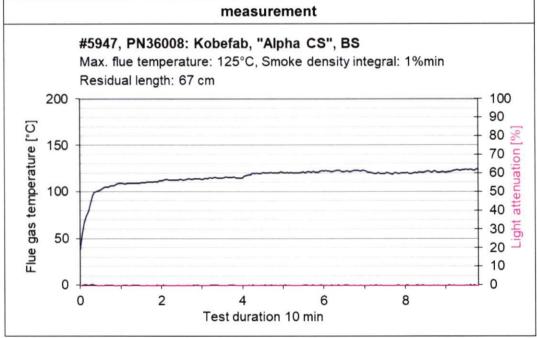

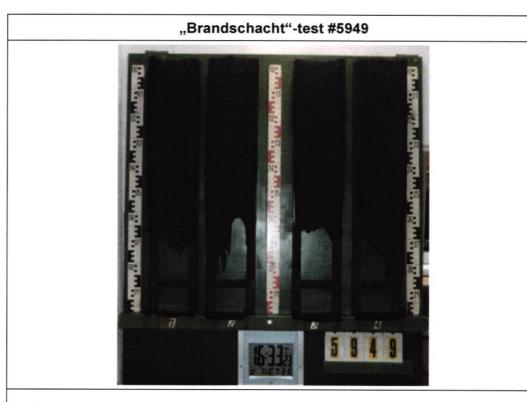

#### measurement #5949, PN36009: Kobefab, "Alpha CS", BK Max. flue temperature: 124°C, Smoke density integral: 1%min Residual length: 66 cm 200 100 90 Flue gas temperature [°C] 80 8 150 70 등 90 attenuation 09 100 30 <del>5</del> 50 20 10 0 2 6 8 Test duration 10 min

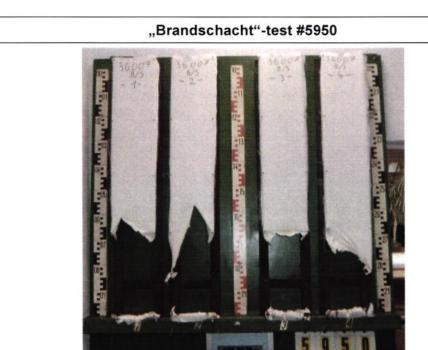

#### measurement #5950, PN36007: Kobefab, "Alpha CS", BS Max. flue temperature: 123°C, Smoke density integral: 1%min Residual length: 66 cm 200 100 90 Flue gas temperature [°C] 80 😤 150 70 00 30 attenuation [ 100 30 <del></del> 5 50 20 10 0 0 0 2 6 8 Test duration 10 min



## Test for normal flammability classifying B2 according to DIN 4102

- 1. <u>Description of test material in condition as delivered</u> look at page 2
- 2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus. The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples -freely suspended-

Flaming in warp and weft direction / Flaming side A and side B

4. Date of test

CW 48 and 49 in 2022

#### 5. Results

PN 36008: flaming side A in weft	edge-test							surface-test					
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Ë
ignition <sup>1)</sup>	1	1	1	1	1		3						s
reaching the mark of measurement <sup>1)2)</sup>	./.	./.	./.	./.	./.		./.						s
max. flame height	12	10	12	12	12		7						cm
time	14	10	12	12	11		8						
self cessation of the flames end of afterflame <sup>1)</sup>	14	13	15	14	12		8						s
end of glowing <sup>1)</sup>	./.	./.	./.	./.	./.		./.						s
flames were extinguished after <sup>1)</sup>	./.	./.	./.	./.	./.		./.						s
smoke development (visual)	moderate								mode	erate			
dropping of burning material during 20 s1)	13	./.	./.	./.	./.		./.						s
Appearance after test: burned out till ma	Appearance after test: burned out till max. height 11cm x width 7cm												

PN 36008: additional tests edge-test surface-test Dim samples no. 1 2 3 4 5 6 2 3 1 4 5 6 arrangement of samples A/K B/K B/S A/K B/K B/S side / direction ignition1) 1 1 1 3 3 3 S ./. ./. ./. ./. ./. ./. reaching the mark of measurement1)2) S 9 9 11 10 10 8 max. flame height -----cm 7 7 10 10 --10 15 -self cessation of the flames 8 8 12 12 17 16 end of afterflame1) S ./. end of glowing<sup>1)</sup> ./. ./. ./. ./. ./. --S ./. ./. ./. ./. ./. ./. flames were extinguished after<sup>1)</sup> S moderate smoke development (visual) moderate ./. ./. ./. ./. ./. dropping of burning material during 20 s1) s Appearance after test: burned out till max. height 11 cm x width 7 cm

K: warp / S: weft

<sup>1)</sup> time mentioned from the beginning of the test 2) during 20 Sec -/- no appearance -- no information

PN 36009: additional tests		edge-test							surface-test					
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	ë	
arrangement of samples side / direction	A/K	B/K	A/S	A/S	-		A/K	B/K	A/S	A/S				
ignition <sup>1)</sup>	1	1	1	1			3	3	3	3	-		s	
reaching the mark of measurement <sup>1)2)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s	
max. flame height	11	11	10	10			7	10	11	11			cm	
time	8	8	10	5			12	14	15	20				
self cessation of the flames end of afterflame <sup>1)</sup>	12	12	15	18	11		14	15	17	29			s	
end of glowing <sup>1)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s	
flames were extinguished after <sup>1)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s	
smoke development (visual)		moderate							mod	erate				
dropping of burning material during 20 s <sup>1)</sup>	./.	10	14	./.			./.	./.	./.	./.			s	
	Appearance after test: burned out till max. height 12 cm x width 6 cm													

PN 36007: additional tests		•	edge	test				s	urfac	e-tes	st		E
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	ë
arrangement of samples side / direction	A/K	B/K	A/S	A/S	-		A/K	B/K	A/S	A/S			
ignition <sup>1)</sup>	1	1	1	1			3	3	3	3			s
reaching the mark of measurement <sup>1)2)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s
max. flame height	8	8	10	10			7	10	11	8			cm
time	10	10	10	10			12	15	14	12			
self cessation of the flames end of afterflame <sup>1)</sup>	10	10	12	12			12	30	15	14	1		s
end of glowing <sup>1)</sup>	./.	./.	./.	./.			./.	./.	./.	./.	1		s
flames were extinguished after <sup>1)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s
smoke development (visual)	moderate								mod	erate			
dropping of burning material during 20 s <sup>1)</sup>	./.	./.	./.	./.			./.	./.	./.	./.			s
Appearance after test: burned out till ma	ax. heiç	ght 10	cm x	width	5 cm								

<sup>1)</sup> time mentioned from the beginning of the test 2) during 20 Sec -/- no appearance -- no information K: warp / S: weft

- 6. Remarks and explanations to the testing procedure none -
- 7. Opinion concerning the dropping of burning material The test for normal flammability shows burning dripping material.